



# Classic Rib on 15/32" Plywood

## Roof Fastener Spacing (feet)

Wind Speed (mph)  
Exposure Category  
**120D**

Roof Slope: 0.5:12 to 1.47:12				
Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	2.00	2.00	2.00	1.75

Roof Slope: 1.47:12 to 6.11:12		
zone 1,2e	z 2n,2r,3e	zone 3r
2.00	2.00	1.50

Roof Slope: 6.11:12 to 12:12		
z 1,2e,2r	z 2n,3r	zone 3e
2.00	2.00	1.75

**130D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	2.00	2.00	2.00	1.50

zone 1,2e	z 2n,2r,3e	zone 3r
2.00	1.50	1.25

z 1,2e,2r	z 2n,3r	zone 3e
2.00	2.00	1.50

**140D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	2.00	2.00	1.75	1.25

zone 1,2e	z 2n,2r,3e	zone 3r
2.00	1.25	1.25

z 1,2e,2r	z 2n,3r	zone 3e
2.00	2.00	1.25

**150D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	2.00	2.00	1.50	1.00

zone 1,2e	z 2n,2r,3e	zone 3r
1.75	1.25	1.00

z 1,2e,2r	z 2n,3r	zone 3e
2.00	1.75	1.00

**160D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	2.00	1.75	1.25	1.00

zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
1.75	1.50	1.00

**170D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	N.G.	N.G.	N.G.	N.G.

zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
N.G.	N.G.	N.G.

**180D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	N.G.	N.G.	N.G.	N.G.

zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
N.G.	N.G.	N.G.

**190D**

Thickness	zone 1'	zone 1	zone 2	zone 3
29 ga	N.G.	N.G.	N.G.	N.G.

zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
N.G.	N.G.	N.G.


**Notes:**

1. Allowable spacing is based on a Design Pressures listed in the FBC 2020 Approval, FL14645.10 and determined by linear interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.


2. Allowable spacing is based on an applied load determined using ASCE 7-16 for the Wind Speeds, Wind Exposure Categories, "Roof Slopes, and Roof Zones shown, assuming 10 square feet of tributary area, Enclosed Gable Roof, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 25 feet.

3. Allowable spacing is determined for wind suction using the pressures shown, resulting from the combination  $0.6DL + 0.6W$ . Also considered is the inward wind pressure, 20 psf live load and the weight of the panel.

#N/A

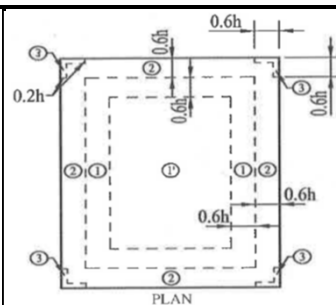

Roof Slope: 0.5:12 to 1.47:12

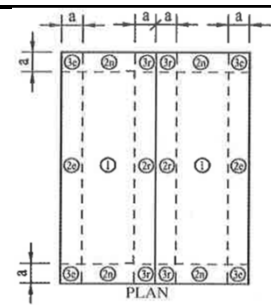

Roof Slope: 1.47:12 to 12:12