



Wall Clip Spacing (feet)

| |
|---------------------------------------|
| Wind Speed (mph) Exposure Category |
| 100C |

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -15.8 psf | -19.5 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 110C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -19.1 psf | -23.6 psf |
| 24 ga | 6.00 | 5.50 |

| |
|------|
| 120C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -22.7 psf | -28.1 psf |
| 24 ga | 5.50 | 4.50 |

| |
|------|
| 130C |
|------|

| | | |
|-----------|-----------|---------|
| | Field | Edge |
| Thickness | -26.7 psf | -33 psf |
| 24 ga | 5.00 | 4.00 |

| |
|------|
| 140C |
|------|

| | | |
|-----------|---------|-----------|
| | Field | Edge |
| Thickness | -31 psf | -38.2 psf |
| 24 ga | 4.00 | 3.50 |

| |
|------|
| 150C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -35.5 psf | -43.9 psf |
| 24 ga | 3.50 | 3.00 |

| |
|------|
| 160C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -40.4 psf | -49.9 psf |
| 24 ga | 3.00 | 2.50 |

| |
|------|
| 170C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -45.7 psf | -56.4 psf |
| 24 ga | 2.50 | 2.00 |

Notes:


1. Allowable spacing is based on a Design Pressures listed in the FBC 2020 Approval, FL34027.2 and determined by linear interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.

2. Allowable spacing is based on an applied load determined using ASCE 7-10 for the Wind Speeds, Wind Exposure Categories, assuming 10 square feet " of tributary area, Enclosed building, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 25 feet.

3. Allowable spacing is determined for wind pressure and suction using the combination 0.6W for each.

- ④ - FIELD
- ⑤ - EDGE

α - LEAST OF 10% MINIMUM BUILDING WIDTH OR 40% OF MEAN ROOF HEIGHT BUT NOT LESS THAN 3'.

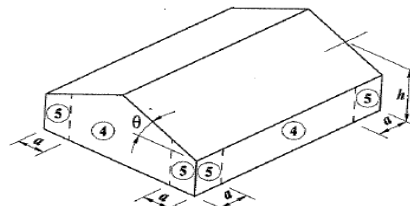

Wall Clip Spacing (feet)

| |
|---------------------------------------|
| Wind Speed (mph) Exposure Category |
| 100C |

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -15.8 psf | -19.5 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 110C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -19.1 psf | -23.6 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 120C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -22.7 psf | -28.1 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 130C |
|------|

| | | |
|-----------|-----------|---------|
| | Field | Edge |
| Thickness | -26.7 psf | -33 psf |
| 24 ga | 6.00 | 5.00 |

| |
|------|
| 140C |
|------|

| | | |
|-----------|---------|-----------|
| | Field | Edge |
| Thickness | -31 psf | -38.2 psf |
| 24 ga | 5.50 | 4.50 |

| |
|------|
| 150C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -35.5 psf | -43.9 psf |
| 24 ga | 5.00 | 4.00 |

| |
|------|
| 160C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -40.4 psf | -49.9 psf |
| 24 ga | 4.00 | 3.50 |

| |
|------|
| 170C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -45.7 psf | -56.4 psf |
| 24 ga | 3.50 | 3.00 |

Notes:

- Allowable spacing is based on a Design Pressures listed in the FBC 2020 Approval, FL34027.2 and determined by linear interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
- Allowable spacing is based on an applied load determined using ASCE 7-10 for the Wind Speeds, Wind Exposure Categories, assuming 10 square feet " of tributary area, Enclosed building, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 25 feet.
- Allowable spacing is determined for wind pressure and suction using the combination $0.6W$ for each.

④ - FIELD α - LEAST OF 10% MINIMUM BUILDING WIDTH OR 40% OF MEAN ROOF HEIGHT BUT NOT LESS THAN 3'.

⑤ - EDGE



Wall Clip Spacing (feet)

| |
|---------------------------------------|
| Wind Speed (mph) Exposure Category |
| 100C |

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -15.8 psf | -19.5 psf |
| 24 ga | 6.00 | 5.00 |

| |
|------|
| 110C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -19.1 psf | -23.6 psf |
| 24 ga | 5.00 | 4.00 |

| |
|------|
| 120C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -22.7 psf | -28.1 psf |
| 24 ga | 4.00 | 3.50 |

| |
|------|
| 130C |
|------|

| | | |
|-----------|-----------|---------|
| | Field | Edge |
| Thickness | -26.7 psf | -33 psf |
| 24 ga | 3.50 | 3.00 |

| |
|------|
| 140C |
|------|

| | | |
|-----------|---------|-----------|
| | Field | Edge |
| Thickness | -31 psf | -38.2 psf |
| 24 ga | 3.00 | 2.50 |

| |
|------|
| 150C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -35.5 psf | -43.9 psf |
| 24 ga | 2.50 | 2.00 |

| |
|------|
| 160C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -40.4 psf | -49.9 psf |
| 24 ga | 2.50 | 2.00 |

| |
|------|
| 170C |
|------|


| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -45.7 psf | -56.4 psf |
| 24 ga | N.G. | N.G. |

Notes:

1. Allowable spacing is based on a Design Pressures listed in the FBC 2020 Approval, FL34027.2 and determined by linear interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
2. Allowable spacing is based on an applied load determined using ASCE 7-10 for the Wind Speeds, Wind Exposure Categories, assuming 10 square feet " of tributary area, Enclosed building, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 25 feet.
3. Allowable spacing is determined for wind pressure and suction using the combination $0.6W$ for each.

N.G. indicates the panel is not recommended for this application.

- ④ - FIELD
 - ⑤ - EDGE
- α - LEAST OF 10% MINIMUM BUILDING WIDTH OR 40% OF MEAN ROOF HEIGHT BUT NOT LESS THAN 3'.

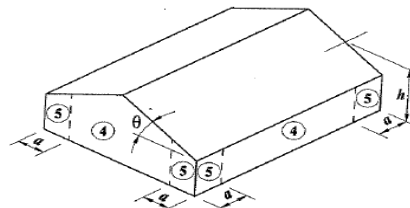

Wall Clip Spacing (feet)

| |
|---------------------------------------|
| Wind Speed (mph) Exposure Category |
| 100C |

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -15.8 psf | -19.5 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 110C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -19.1 psf | -23.6 psf |
| 24 ga | 6.00 | 6.00 |

| |
|------|
| 120C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -22.7 psf | -28.1 psf |
| 24 ga | 6.00 | 5.50 |

| |
|------|
| 130C |
|------|

| | | |
|-----------|-----------|---------|
| | Field | Edge |
| Thickness | -26.7 psf | -33 psf |
| 24 ga | 5.50 | 4.50 |

| |
|------|
| 140C |
|------|

| | | |
|-----------|---------|-----------|
| | Field | Edge |
| Thickness | -31 psf | -38.2 psf |
| 24 ga | 5.00 | 4.00 |

| |
|------|
| 150C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -35.5 psf | -43.9 psf |
| 24 ga | 4.00 | 3.50 |

| |
|------|
| 160C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -40.4 psf | -49.9 psf |
| 24 ga | 3.50 | 3.00 |

| |
|------|
| 170C |
|------|

| | | |
|-----------|-----------|-----------|
| | Field | Edge |
| Thickness | -45.7 psf | -56.4 psf |
| 24 ga | 3.00 | 2.50 |

Notes:

- Allowable spacing is based on a Design Pressures listed in the FBC 2020 Approval, FL34027.2 and determined by linear interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
- Allowable spacing is based on an applied load determined using ASCE 7-10 for the Wind Speeds, Wind Exposure Categories, assuming 10 square feet " of tributary area, Enclosed building, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 25 feet.
- Allowable spacing is determined for wind pressure and suction using the combination $0.6W$ for each.

④ - FIELD α - LEAST OF 10% MINIMUM BUILDING WIDTH OR 40% OF MEAN ROOF HEIGHT BUT NOT LESS THAN 3'.

⑤ - EDGE