



Classic Rib on 19/32" Plywood

Roof Fastener Spacing (feet)

Wind Speed (mph)
Exposure Category
110C

Roof Slope: 0.5:12 to 1.5:12				
Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	3.00

Roof Slope: 1.5:12 to 6:12		
zone 1,2e	z 2n,2r,3e	zone 3r
3.00	3.00	3.00

Roof Slope: 6:12 to 12:12		
z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	3.00

120C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	3.00

zone 1,2e	z 2n,2r,3e	zone 3r
3.00	3.00	3.00

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	3.00

130C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	3.00

zone 1,2e	z 2n,2r,3e	zone 3r
3.00	3.00	3.00

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	3.00

140C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	2.75

zone 1,2e	z 2n,2r,3e	zone 3r
3.00	3.00	2.25

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	2.75

150C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
3.00	2.25	1.50

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	2.00

160C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	3.00	1.25

zone 1,2e	z 2n,2r,3e	zone 3r
3.00	1.75	0.50

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	1.25

170C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	3.00	3.00	2.25	0.50

zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
3.00	3.00	0.50

180C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	N.G.	N.G.	N.G.	N.G.


zone 1,2e	z 2n,2r,3e	zone 3r
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
N.G.	N.G.	N.G.

Notes:

1. Allowable spacing is based on a Design Pressures listed in the Miami-Dade NOA, 21-0629.10 Table A and determined by linear of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
2. Allowable spacing is based on an applied load determined using ASCE 7-16 for the Wind Speeds, Wind Exposure Categories, "Roof Slopes, and Roof Zones shown, assuming 10 square feet of tributary area, Enclosed Gable Roof, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 20 feet.
3. Allowable spacing is determined for wind suction using the pressures shown, resulting from the combination $0.6DL + 0.6W$. Also considered is the inward wind pressure, 20 psf live load and the weight of the panel.

#N/A

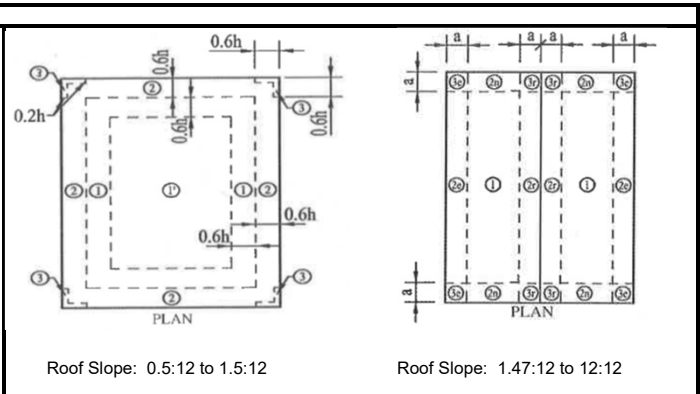



Classic Rib on 19/32" Plywood

Roof Fastener Spacing (feet)

Wind Speed (mph)
Exposure Category
110C

Roof Slope: 0.5:12 to 1.5:12				
Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-14.9 psf	-26.3 psf	-34.9 psf	-47.7 psf
	2.00	2.00	2.00	2.00

Roof Slope: 1.5:12 to 6:12		
zone 1,2e	z 2n,2r,3e	zone 3r
-30.6 psf	-44.8 psf	-53.4 psf
2.00	2.00	2.00

Roof Slope: 6:12 to 12:12		
z 1,2e,2r	z 2n,3r	zone 3e
-27.7 psf	-30.6 psf	-47.7 psf
2.00	2.00	2.00

120C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-17.8 psf	-31.4 psf	-41.6 psf	-56.8 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-36.5 psf	-53.4 psf	-63.6 psf
2.00	2.00	2.00

z 1,2e,2r	z 2n,3r	zone 3e
-33.1 psf	-36.5 psf	-56.8 psf
2.00	2.00	2.00

130C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-21 psf	-36.9 psf	-48.9 psf	-66.8 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-42.9 psf	-62.8 psf	-74.7 psf
2.00	2.00	2.00

z 1,2e,2r	z 2n,3r	zone 3e
-38.9 psf	-42.9 psf	-66.8 psf
2.00	2.00	2.00

140C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-24.4 psf	-42.9 psf	-56.8 psf	-77.5 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-49.8 psf	-72.9 psf	-86.8 psf
2.00	2.00	2.00

z 1,2e,2r	z 2n,3r	zone 3e
-45.2 psf	-49.8 psf	-77.5 psf
2.00	2.00	2.00

150C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-28.1 psf	-49.3 psf	-65.2 psf	-89.1 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-57.3 psf	-83.8 psf	-99.7 psf
2.00	2.00	0.50*

z 1,2e,2r	z 2n,3r	zone 3e
-52 psf	-57.3 psf	-89.1 psf
2.00	2.00	2.00

160C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-32.1 psf	-56.2 psf	-74.3 psf	-101.4 psf
	2.00	2.00	2.00	0.50*

zone 1,2e	z 2n,2r,3e	zone 3r
-65.2 psf	-95.4 psf	-113.5 psf
2.00	0.50*	0.50*

z 1,2e,2r	z 2n,3r	zone 3e
-59.2 psf	-65.2 psf	-101.4 psf
2.00	2.00	0.50*

170C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-36.3 psf	-63.5 psf	-83.9 psf	-114.5 psf
	2.00	2.00	2.00	0.50*

zone 1,2e	z 2n,2r,3e	zone 3r
-73.7 psf	-107.7 psf	-128.2 psf
2.00	0.50*	0.50*

z 1,2e,2r	z 2n,3r	zone 3e
-66.9 psf	-73.7 psf	-114.5 psf
2.00	2.00	0.50*

180C

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-40.7 psf	-71.2 psf	-94.1 psf	-128.5 psf
	2.00	2.00	0.50*	0.50*

zone 1,2e	z 2n,2r,3e	zone 3r
-82.7 psf	-120.8 psf	-143.7 psf
N.G.	N.G.	N.G.


z 1,2e,2r	z 2n,3r	zone 3e
-75.1 psf	-82.7 psf	-128.5 psf
2.00	2.00	0.50*

Notes:


- Allowable spacing is based on a Design Pressures listed in the Miami-Dade NOA, 21-0629.10 Table B and determined by linear of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
- Allowable spacing is based on an applied load determined using ASCE 7-16 for the Wind Speeds, Wind Exposure Categories, "Roof Slopes, and Roof Zones shown, assuming 10 square feet of tributary area, Enclosed Gable Roof, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 20 feet.
- Allowable spacing is determined for wind suction using the pressures shown, resulting from the combination $0.6DL + 0.6W$. Also considered is the inward wind pressure, 20 psf live load and the weight of the panel.

* - Indicates that fasteners are required in both sides of each rib.

#N/A

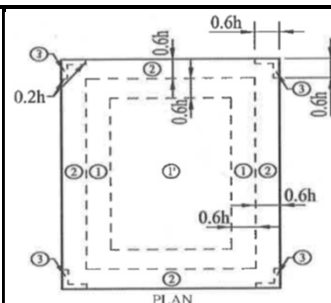

Roof Slope: 0.5:12 to 1.5:12

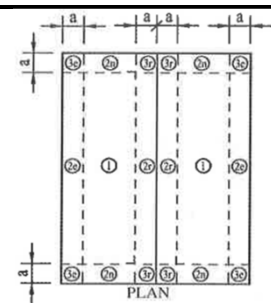

Roof Slope: 1.47:12 to 12:12