




5V-Crimp on 19/32" Plywood

Roof Fastener Spacing (feet)

Wind Speed (mph) Exposure Category	Roof Slope: 0.5:12 to 1.47:12				Roof Slope: 1.48:12 to 6.11:12			Roof Slope: 6.12:12 to 12:12			
	Thickness	zone 1'	zone 1	zone 2	zone 3	zone 1,2e	z 2n,2r,3e	zone 3r	z 1,2e,2r	z 2n,3r	zone 3e
120D	26 ga	1.33	1.33	1.33	1.33	1.33	1.33	1.00	1.33	1.33	1.33
		-23.1 psf	-40.6 psf	-53.7 psf	-73.4 psf	-47.2 psf	-69 psf	-82.1 psf	-42.8 psf	-47.2 psf	-73.4 psf
130D	26 ga	1.33	1.33	1.33	1.00	1.33	1.00	1.00	1.33	1.33	1.00
		-27.2 psf	-47.7 psf	-63.1 psf	-86.2 psf	-55.4 psf	-81.1 psf	-96.5 psf	-50.3 psf	-55.4 psf	-86.2 psf
140D	26 ga	1.33	1.33	1.33	0.67	1.33	1.00	0.67	1.33	1.33	0.67
		-31.6 psf	-55.4 psf	-73.3 psf	-100.1 psf	-64.4 psf	-94.1 psf	-111.9 psf	-58.4 psf	-64.4 psf	-100.1 psf
150D	26 ga	1.33	1.33	1.00	0.67	1.33	0.67	0.67	1.33	1.33	0.67
		-36.4 psf	-63.7 psf	-84.2 psf	-114.9 psf	-74 psf	-108.1 psf	-128.6 psf	-67.1 psf	-74 psf	-114.9 psf
160D	26 ga	1.33	1.33	1.00	0.67	1.00	0.67	0.67	1.00	1.00	0.67
		-41.5 psf	-72.6 psf	-95.9 psf	-130.8 psf	-84.2 psf	-123.1 psf	-146.4 psf	-76.4 psf	-84.2 psf	-130.8 psf
170D	26 ga	1.33	1.00	0.67	0.67	1.00	0.67	0.67	1.00	1.00	0.67
		-46.9 psf	-82 psf	-108.3 psf	-147.8 psf	-95.1 psf	-139 psf	-165.3 psf	-86.4 psf	-95.1 psf	-147.8 psf
180D	26 ga	1.33	1.00	0.67	0.67	0.67	0.67	0.67	1.00	0.67	0.67
		-52.6 psf	-92 psf	-121.5 psf	-165.7 psf	-106.7 psf	-155.9 psf	-185.4 psf	-96.9 psf	-106.7 psf	-165.7 psf
190D	26 ga	1.33	0.67	0.67	0.67	N.G.	N.G.	N.G.	0.67	0.67	0.67
		-58.7 psf	-102.5 psf	-135.4 psf	-184.7 psf	-118.9 psf	-173.7 psf	-206.6 psf	-108 psf	-118.9 psf	-184.7 psf

Notes:

- Allowable spacing is based on a Design Pressures listed in the Miami-Dade NOA, 23-0222.06 Table A and determined by linear of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
- Allowable spacing is based on an applied load determined using ASCE 7-16 for the Wind Speeds, Wind Exposure Categories, "Roof Slopes, and Roof Zones shown, assuming 10 square feet of tributary area, Enclosed Gable Roof, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 30 feet.
- Allowable spacing is determined for wind suction using the pressures shown, resulting from the combination $0.6DL + 0.6W$. Also considered is the inward wind pressure, 20 psf live load and the weight of the panel.

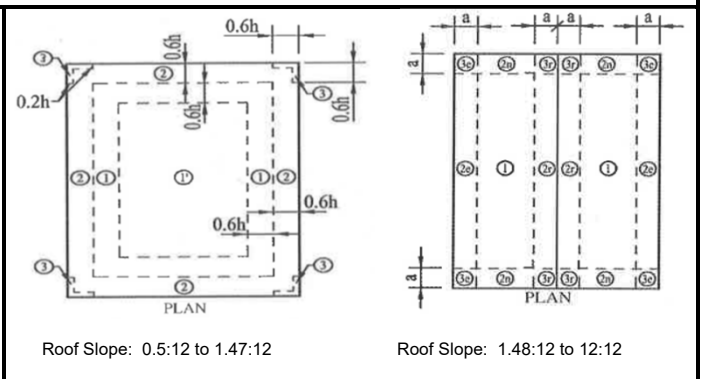



5V-Crimp on 19/32" Plywood

Roof Fastener Spacing (feet)

Wind Speed (mph)
Exposure Category
100D

Roof Slope: 0.5:12 to 1.47:12				
Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-15.9 psf	-28.1 psf	-37.2 psf	-50.8 psf
	2.00	2.00	2.00	2.00

Roof Slope: 1.48:12 to 6.11:12		
zone 1,2e	z 2n,2r,3e	zone 3r
-32.6 psf	-47.8 psf	-56.9 psf
2.00	2.00	2.00

Roof Slope: 6.12:12 to 12:12		
z 1,2e,2r	z 2n,3r	zone 3e
-29.6 psf	-32.6 psf	-50.8 psf
2.00	2.00	2.00

110D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-19.4 psf	-34 psf	-45.1 psf	-61.6 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-39.6 psf	-57.9 psf	-68.9 psf
2.00	2.00	2.00

z 1,2e,2r	z 2n,3r	zone 3e
-35.9 psf	-39.6 psf	-61.6 psf
2.00	2.00	2.00

120D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-23.1 psf	-40.6 psf	-53.7 psf	-73.4 psf
	2.00	2.00	2.00	2.00

zone 1,2e	z 2n,2r,3e	zone 3r
-47.2 psf	-69 psf	-82.1 psf
2.00	2.00	2.00

z 1,2e,2r	z 2n,3r	zone 3e
-42.8 psf	-47.2 psf	-73.4 psf
2.00	2.00	2.00

130D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-27.2 psf	-47.7 psf	-63.1 psf	-86.2 psf
	2.00	2.00	2.00	1.75

zone 1,2e	z 2n,2r,3e	zone 3r
-55.4 psf	-81.1 psf	-96.5 psf
2.00	2.00	1.75

z 1,2e,2r	z 2n,3r	zone 3e
-50.3 psf	-55.4 psf	-86.2 psf
2.00	2.00	1.75

140D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-31.6 psf	-55.4 psf	-73.3 psf	-100.1 psf
	2.00	2.00	2.00	1.50

zone 1,2e	z 2n,2r,3e	zone 3r
-64.4 psf	-94.1 psf	-111.9 psf
2.00	1.75	1.50

z 1,2e,2r	z 2n,3r	zone 3e
-58.4 psf	-64.4 psf	-100.1 psf
2.00	2.00	1.50

150D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-36.4 psf	-63.7 psf	-84.2 psf	-114.9 psf
	2.00	2.00	2.00	1.50

zone 1,2e	z 2n,2r,3e	zone 3r
-74 psf	-108.1 psf	-128.6 psf
2.00	1.50	1.50

z 1,2e,2r	z 2n,3r	zone 3e
-67.1 psf	-74 psf	-114.9 psf
2.00	2.00	1.50

160D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-41.5 psf	-72.6 psf	-95.9 psf	-130.8 psf
	2.00	2.00	1.75	1.50

zone 1,2e	z 2n,2r,3e	zone 3r
-84.2 psf	-123.1 psf	-146.4 psf
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
-76.4 psf	-84.2 psf	-130.8 psf
2.00	2.00	1.50

170D

Thickness	zone 1'	zone 1	zone 2	zone 3
26 ga	-46.9 psf	-82 psf	-108.3 psf	-147.8 psf
	N.G.	N.G.	N.G.	N.G.

zone 1,2e	z 2n,2r,3e	zone 3r
-95.1 psf	-139 psf	-165.3 psf
N.G.	N.G.	N.G.

z 1,2e,2r	z 2n,3r	zone 3e
-86.4 psf	-95.1 psf	-147.8 psf
N.G.	N.G.	N.G.

Notes:

1. Allowable spacing is based on a Design Pressures listed in the Miami-Dade NOA, 23-0222.06 Table B and determined by linear of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval.
2. Allowable spacing is based on an applied load determined using ASCE 7-16 for the Wind Speeds, Wind Exposure Categories, "Roof Slopes, and Roof Zones shown, assuming 10 square feet of tributary area, Enclosed Gable Roof, 3 or more span case, Topographic Factor of 1, and Mean Roof Height of 30 feet.
3. Allowable spacing is determined for wind suction using the pressures shown, resulting from the combination $0.6DL + 0.6W$. Also considered is the inward wind pressure, 20 psf live load and the weight of the panel.

