

Wall Fastener Spacing (feet)

Wind Speed (mph) Exposure Category
100C

	Field	Edge
Thickness	-16.4 psf	-20.3 psf
26 ga	4.00	4.00

120C

	Field	Edge
Thickness	-23.6 psf	-29.2 psf
26 ga	4.00	4.00

140C

	Field	Edge
Thickness	-32.2 psf	-39.7 psf
26 ga	3.50	3.00

160C

	Field	Edge
Thickness	-42 psf	-51.9 psf
26 ga	2.75	2.25

180C

	Field	Edge
Thickness	-53.2 psf	-65.7 psf
26 ga	2.25	2.00

200C

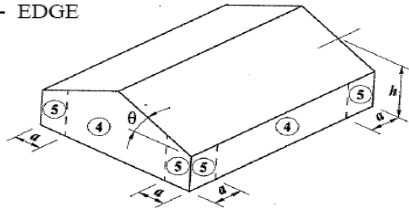
	Field	Edge
Thickness	-65.7 psf	-81 psf
26 ga	2.00	2.00

220C

	Field	Edge
Thickness	-79.4 psf	-98.1 psf
26 ga	2.00	2.00

240C

	Field	Edge
Thickness	-94.6 psf	-116.7 psf
26 ga	N.G.	N.G.

<p>Notes:</p> <ol style="list-style-type: none"> Allowable spacing is based on a Design Pressures listed in the FBC 2023 Approval, FL9482.2 and determined by interpolation of those values. 1/3 increase is not included for wind. The fasteners and fastening patterns are shown in the Approval. Allowable spacing is based on an applied load determined using ASCE 7-22 for the Wind Speeds, Wind Exposure Categories, assuming 10 square feet " of tributary area, Enclosed building, 3 or more span case, Topographic Factor of 1 and Mean Roof Height of 30 feet. Tornado loads are not considered. Allowable spacing is determined for wind pressure and suction using the combination 0.6W for each. <p>N.G. indicates the panel is not recommended for this application.</p>	<p>a - LEAST OF 10% MINIMUM BUILDING WIDTH OR 40% OF MEAN ROOF HEIGHT BUT NOT LESS THAN 3'.</p> <p>④ - FIELD ⑤ - EDGE</p> 
---	---