

ARCHITECTURAL  
RESIDENTIAL  
PANEL

EXPOSED  
FASTENED


24"  
COVERAGE

MINIMUM  
SLOPE  
3:12

SOLID WOOD  
SUBSTRATE

### PANEL OVERVIEW


- Finishes: MS Colorfast45® and Acrylic-Coated Galvalume®
- Corrosion Protection: AZ55 per ASTM A 792 for unpainted Galvalume®  
AZ50 per ASTM A 792 for painted Galvalume®  
G90 per ASTM A 653 for Galvanized
- Gauges: 26 ga standard; 29 ga and 24 ga optional
- 24" panel coverage,  $\frac{1}{2}$ " rib height
- Panel Length: Minimum: 5'; Maximum: 45' recommended
- Residential, 'V' rib roof system
- Minimum roof slope: 3:12
- Applies over plywood with minimum 30# felt underlayment

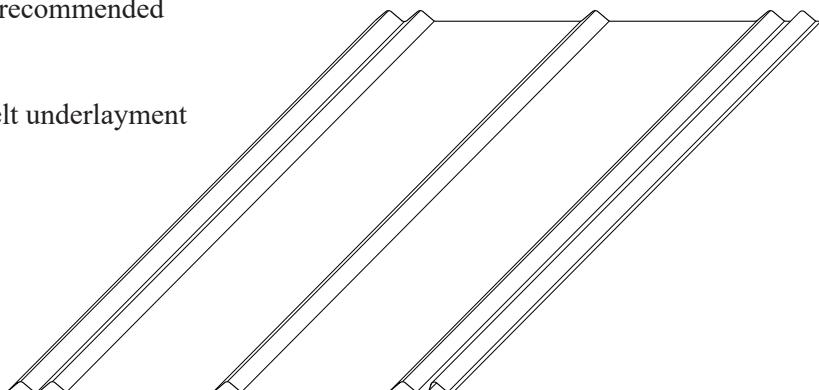

### TESTING AND APPROVALS


- UL 2218 Impact Resistance - Class 4
- UL 790 Fire Resistance Rating - Class A, per building code
- UL 263 Fire Resistance Rating - per assembly
- UL 580 Uplift Resistance - Class 90 Constructions: #579 and #453
- Texas Windstorm - Evaluation RC-160
- 2023 FBC Approvals - FL14645.2 and FL14645.3
- Miami-Dade County, Florida NOA 23-0711.03 expires 6/5/2030  
23-0222.06 expires 6/29/2028

### FASTENING PATTERN

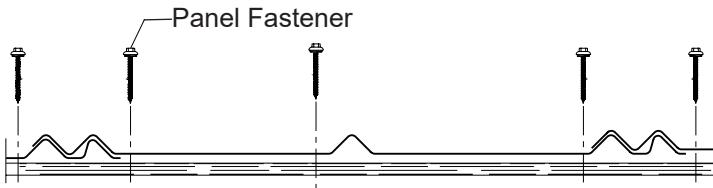


### ALTERNATE FASTENING PATTERN

#### Field of Panel

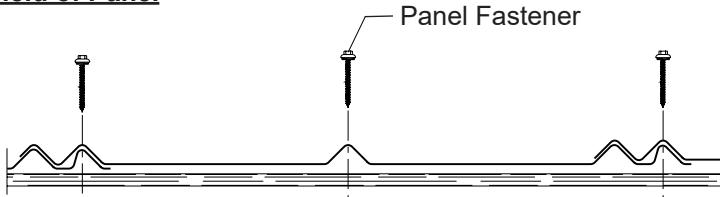

#### Ends of Panel

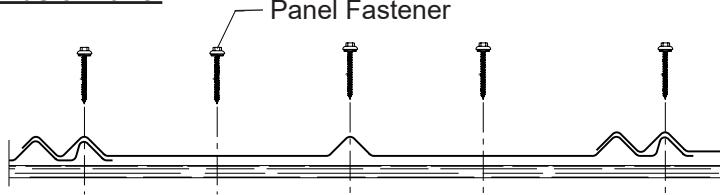

### FASTENER INFORMATION

Overdriven fasteners will cause panel distortions.

Fasteners should extend 1/2" or more past the inside face of the support material.

Thick supports (ex. 1/2" steel) may require predrilling of holes for screws.

Applications with large internal suction pressure, such as partially enclosed structures and those with forced air ventilation, should add sidelap sealant to improve weather resistance.

The minimum roof slope permitted by IBC for metal panels with no sidelap sealant is 3:12. For metal panels with sidelap sealant, IBC permits a minimum slope as low as 1/2:12.

#### Panel Fastener:

Attaching to Wood:  
#10-14 Wood Screw  
#10-14 XL Wood Screw

#### Trim Fastener:

1/4"-14 x 7/8" Stitch Screw  
1/4"-14 x 7/8" XL Stitch Screw

SECTION PROPERTIES							ALLOWABLE UNIFORM LOADS, psf For various fastener spacings						
Ga	Width in	Yield ksi	Weight psf	Top In Compression		Bottom In Compression		Outward Load					
				I <sub>xx</sub> in <sup>4</sup> /ft	S <sub>xx</sub> in <sup>3</sup> /ft	I <sub>xx</sub> in <sup>4</sup> /ft	S <sub>xx</sub> in <sup>3</sup> /ft	0.5'	1'	1.5'	2'	2.5'	3'
26	24	50	0.78	0.0025	0.0070	0.0015	0.0055	197	100	71	62	50	42
24	24	50	1.02	0.0030	0.0089	0.0020	0.0073	197	100	71	62	50	42

1. Theoretical section properties have been calculated per AISI 2016 'North American Specification for the Design of Cold-Formed Steel Structural Members'. I<sub>xx</sub> and S<sub>xx</sub> are effective section properties for deflection and bending.  
 2. Allowable load is calculated in accordance with AISI 2016 specifications considering bending, shear, combined bending & shear and deflection. Allowable load does not address web crippling, fasteners, support material or load testing. Allowable load considers the three or more equal spans condition. Panel weight is not considered.  
 3. Deflection consideration is limited by a maximum deflection ratio of L/180 of span.  
 4. Allowable loads do not include a 1/3 stress increase for wind.